

---

***WATER QUALITY TESTING***

***FOR***

***GENEVA COMMUNITY UNIT SCHOOL DISTRICT 304  
HIGH SCHOOL***

***GENEVA, ILLINOIS***

***SEPTEMBER 12, 2017***

***PROJECT NUMBER: 17-18349***



A DIVISION OF GALLAGHER BASSETT SERVICES, INC.

1550 Hubbard Ave., Batavia, IL 60510, 630-879-3006

**TABLE OF CONTENTS**

INTRODUCTION..... 1

RESULTS..... 1

PROFESSIONAL CERTIFICATION..... 1

Appendix I: Sample Locations and Sample Map

Appendix II: Laboratory Results

## **INTRODUCTION**

Geneva Community Unit School District 304 implemented a proactive program of water testing at Geneva High School. Water sampling was conducted by Kathryn Hermann of Aires Consulting on September 12, 2017. Mr. Geoffrey J. Bacci II, P.E. designed the studied and developed this report.

Testing was limited to the Little Vikings Preschool Room (EE180) and the kitchen sinks which are utilized to prepare meals for the elementary schools covered by the Lead in Drinking Water Testing Bill (LDWTB) effective January 17, 2017.

All sampling methodology followed protocol required by The Lead in Drinking Water Testing Bill (LDWTB) an guidelines published by the Illinois Department of Public Health (IDPH). Detailed background information on testing requirements, methodology and lead health effects are included in the main report to the District that summarizes results and offers recommendations.

## **RESULTS**


Field sheets identifying sample numbers and sample locations maps are included in Appendix I. Laboratory results are included in Appendix II.

There were no detectable (< 2.0 ppb) concentrations of lead in any of the water samples analyzed.

## **PROFESSIONAL CERTIFICATION**

Aires Consulting, a division of Gallagher Bassett Services, Inc. conducted this study in the interest of Geneva Community Unit School District 304 to assist in meeting environmental obligations and regulations. In this respect, we hope the results of this study are useful. *This study was not intended to include every environmental exposure that may be present at the facility; only those items specifically addressed in the report were evaluated.* If you have any questions concerning this study please let us know.

Respectfully Submitted,




---

Geoffrey J. Bacci II, P.E.  
Director of Operations

1 - Sink  
0 - Drinking fountain

### GENEVA HIGH SCHOOL MASTER MAP - 1ST FLOOR

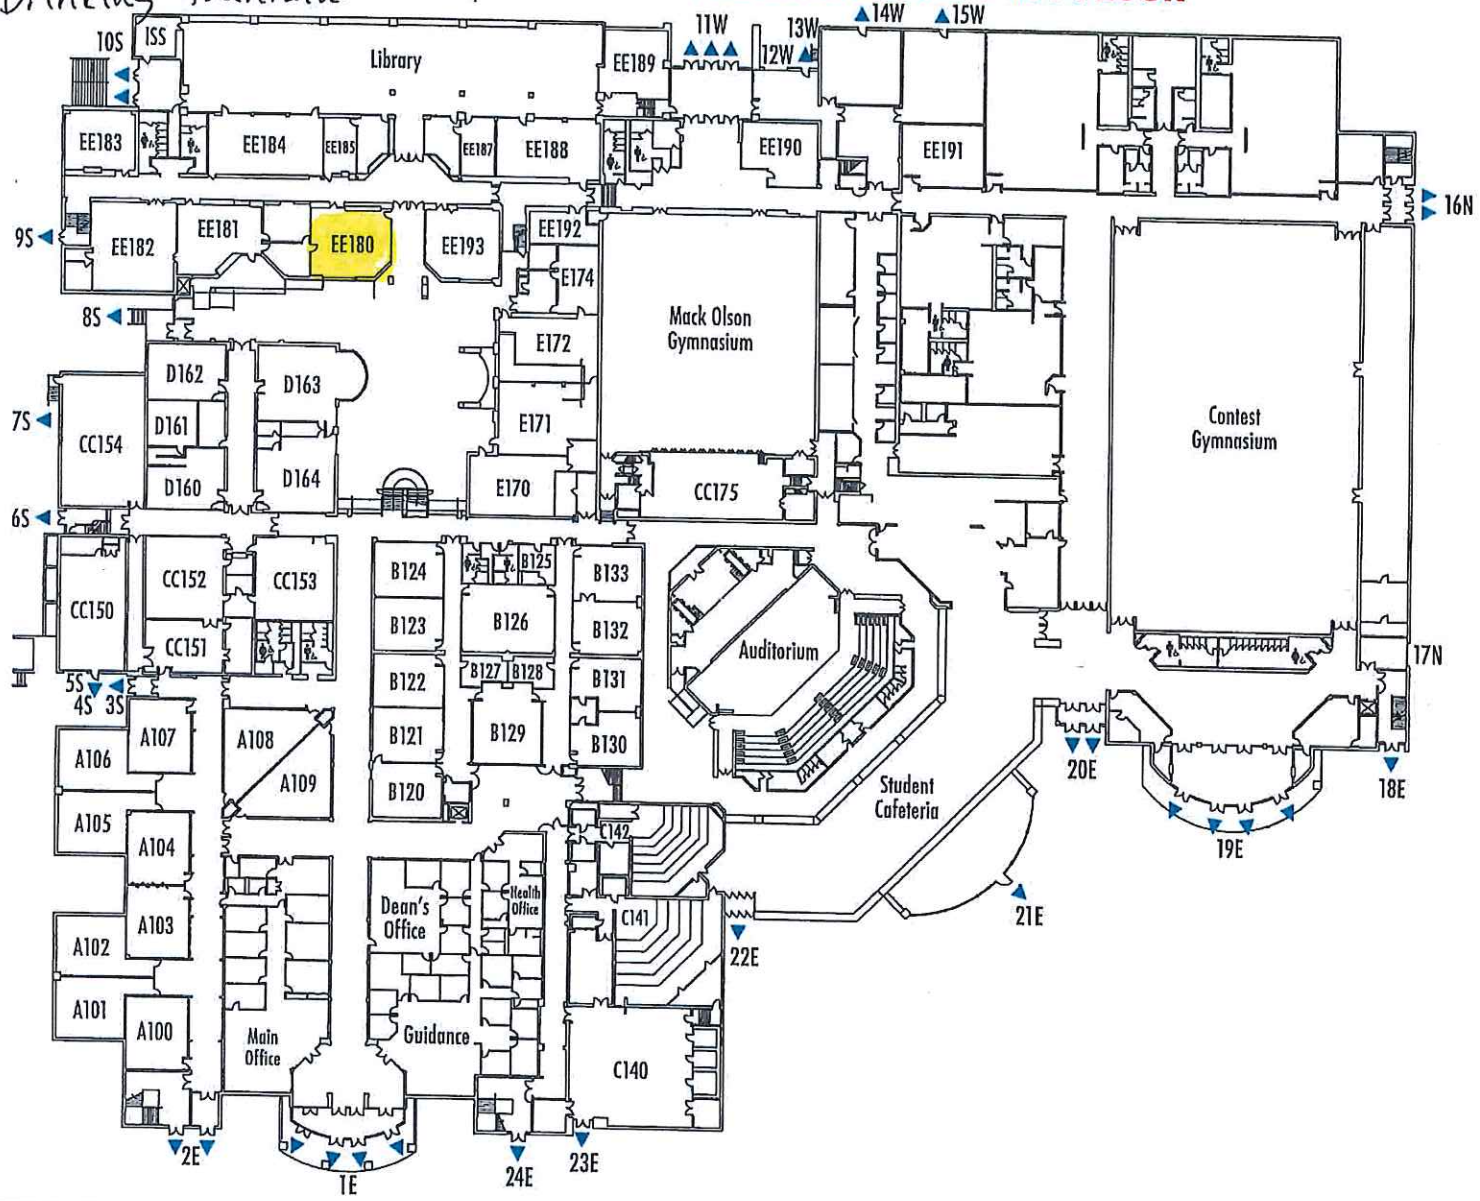

ISBE ID	Building ID	Building Description	Sample Date	Sample Time (12 HR Clock)	Collected By	Sample ID Number	Sample Location Description	Fixture Type	Date of Last Use	Time of Last Use (12 HR Clock)	Sample Type	Sample Volume (mL)	Laboratory Name	Analytical Method	Concentration (ug/L)	Reporting Limit (ug/L)	Notes
310453040260001			09/12/2017	05:36 AM	Kathryn Hermann	GHSKS-1A	S. Side - E Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:37 AM	Kathryn Hermann	GHSKS-1B	S. Side - E Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:38 AM	Kathryn Hermann	GHSKS-2A	S. Side - W Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:39 AM	Kathryn Hermann	GHSKS-2B	S. Side - W Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:41 AM	Kathryn Hermann	GHSKS-3A	W. Side - N Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:42 AM	Kathryn Hermann	GHSKS-3B	W. Side - N Corner	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:43 AM	Kathryn Hermann	GHSKS-4A	W. Side - Furthest up	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:44 AM	Kathryn Hermann	GHSKS-4B	W. Side - Furthest up	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:45 AM	Kathryn Hermann	GHSKS-5A	W. Side -middle	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:46 AM	Kathryn Hermann	GHSKS-5B	W. Side -middle	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:47 AM	Kathryn Hermann	GHSKS-6A	W. Side- bottom	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:48 AM	Kathryn Hermann	GHSKS-6B	W. Side- bottom	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:50 AM	Kathryn Hermann	GHSKS-7A	N. side - W corner	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:51 AM	Kathryn Hermann	GHSKS-7B	N. side - W corner	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:52 AM	Kathryn Hermann	GHSKS-8A	N. side - E corner	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:53 AM	Kathryn Hermann	GHSKS-8B	N. side - E corner	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:55 AM	Kathryn Hermann	GHSKS-9A	Spigot Near Stove	KS - Kitchen Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	05:56 AM	Kathryn Hermann	GHSKS-9B	Spigot Near Stove	KS - Kitchen Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	06:07 AM	Kathryn Hermann	GHSS-10A	Room EE180	S - Sink	09/11/2017	02:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
310453040260001			09/12/2017	06:08 AM	Kathryn Hermann	GHSS-10B	Room EE180	S - Sink	09/11/2017	02:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	



Tuesday, October 3, 2017

Geoff Bacci II  
 Aires Consulting Group  
 1550 Hubbard Ave.  
 Batavia, IL 60510  
 TEL: (630) 879-3006  
 FAX: (630) 879-3014

RE: 17-18349 Geneva High School

PAS WO: 1710493

Prairie Analytical Systems, Inc. received 20 sample(s) on 9/15/2017 for the analyses presented in the following report.

All applicable quality control procedures met method specific acceptance criteria unless otherwise noted.

This report shall not be reproduced, except in full, without the prior written consent of Prairie Analytical Systems, Inc.

If you have any questions, please feel free to contact me at (224) 253-1348.

Respectfully submitted,

A handwritten signature in black ink, appearing to read "Christina E. Pierce".

Christina E. Pierce  
 Project Manager

**Certifications:** NELAP/NELAC - IL #100323

---

1210 Capital Airport Drive	*	Springfield, IL 62707	*	1.217.753.1148	*	1.217.753.1152 Fax
9114 Virginia Road Suite #112	*	Lake in the Hills, IL 60156	*	1.847.651.2604	*	1.847.458.0538 Fax

Prairie Analytical Systems, Inc.

Date: 10/3/2017

## LABORATORY RESULTS

Client: Aires Consulting Group  
 Project: 17-18349 Geneva High School  
 Client Sample ID: GHSKS-1A  
 Collection Date: 9/12/17 5:36

Lab Order: 17I0493  
 Lab ID: 17I0493-01  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:23	EPA200.8	LAH

Client Sample ID: GHSKS-1B  
 Collection Date: 9/12/17 5:37

Lab ID: 17I0493-02  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:26	EPA200.8	LAH

Client Sample ID: GHSKS-2A  
 Collection Date: 9/12/17 5:38

Lab ID: 17I0493-03  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:29	EPA200.8	LAH

Client Sample ID: GHSKS-2B  
 Collection Date: 9/12/17 5:39

Lab ID: 17I0493-04  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:32	EPA200.8	LAH

Client Sample ID: GHSKS-3A  
 Collection Date: 9/12/17 5:41

Lab ID: 17I0493-05  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:35	EPA200.8	LAH

Client Sample ID: GHSKS-3B  
 Collection Date: 9/12/17 5:42

Lab ID: 17I0493-06  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:37	EPA200.8	LAH

Client Sample ID: GHSKS-4A  
 Collection Date: 9/12/17 5:43

Lab ID: 17I0493-07  
 Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:49	EPA200.8	LAH



Prairie Analytical Systems, Inc.

Date: 10/3/2017

## LABORATORY RESULTS

**Client:** Aires Consulting Group  
**Project:** 17-18349 Geneva High School

**Lab Order:** 17I0493

**Client Sample ID:** GHSKS-4B  
**Collection Date:** 9/12/17 5:44

**Lab ID:** 17I0493-08  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 3:52	EPA200.8	LAH

**Client Sample ID:** GHSKS-5A  
**Collection Date:** 9/12/17 5:45

**Lab ID:** 17I0493-09  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:00	EPA200.8	LAH

**Client Sample ID:** GHSKS-5B  
**Collection Date:** 9/12/17 5:46

**Lab ID:** 17I0493-10  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:03	EPA200.8	LAH

**Client Sample ID:** GHSKS-6A  
**Collection Date:** 9/12/17 5:47

**Lab ID:** 17I0493-11  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:06	EPA200.8	LAH

**Client Sample ID:** GHSKS-6B  
**Collection Date:** 9/12/17 5:48

**Lab ID:** 17I0493-12  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:09	EPA200.8	LAH

**Client Sample ID:** GHSKS-7A  
**Collection Date:** 9/12/17 5:50

**Lab ID:** 17I0493-13  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:12	EPA200.8	LAH

**Client Sample ID:** GHSKS-7B  
**Collection Date:** 9/12/17 5:51

**Lab ID:** 17I0493-14  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
<b>Metals by ICP-MS</b>									
*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:15	EPA200.8	LAH

Prairie Analytical Systems, Inc.

Date: 10/3/2017

## LABORATORY RESULTS

**Client:** Aires Consulting Group  
**Project:** 17-18349 Geneva High School  
**Client Sample ID:** GHSKS-7B  
**Collection Date:** 9/12/17 5:51

**Lab Order:** 17I0493  
**Lab ID:** 17I0493-14  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Client Sample ID:** GHSKS-8A  
**Collection Date:** 9/12/17 5:52

**Lab ID:** 17I0493-15  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:29	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

**Client Sample ID:** GHSKS-8B  
**Collection Date:** 9/12/17 5:53

**Lab ID:** 17I0493-16  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:32	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

**Client Sample ID:** GHSKS-9A  
**Collection Date:** 9/12/17 5:55

**Lab ID:** 17I0493-17  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 12:56	9/29/17 4:35	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

**Client Sample ID:** GHSKS-9B  
**Collection Date:** 9/12/17 5:56

**Lab ID:** 17I0493-18  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 13:01	9/29/17 4:43	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

**Client Sample ID:** GHSS-10A  
**Collection Date:** 9/12/17 6:07

**Lab ID:** 17I0493-19  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 13:01	9/29/17 4:52	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

**Client Sample ID:** GHSS-10B  
**Collection Date:** 9/12/17 6:08

**Lab ID:** 17I0493-20  
**Matrix:** Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

**Metals by ICP-MS**

*Lead	U	2.00		µg/L	1	9/28/17 13:01	9/29/17 4:55	EPA200.8	LAH
-------	---	------	--	------	---	---------------	--------------	----------	-----

Prairie Analytical Systems, Inc.

Date: 10/3/2017

## LABORATORY RESULTS

Client: Aires Consulting Group  
 Project: 17-18349 Geneva High School

Lab Order: 17I0493

## Metals by ICP-MS - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

**Batch A005995 - EPA 200.8 Metals****Blank (A005995-BLK1)**

Prepared: 09/28/201 Analyzed: 09/29/201

Lead U 2.00 µg/L

**LCS (A005995-BS1)**

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 510 2.00 µg/L 500.00 102 85-115

**Matrix Spike (A005995-MS1)**

Source: 17I0492-04

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 494 2.00 µg/L 500.00 0.245 99 75-125

**Matrix Spike (A005995-MS2)**

Source: 17I0493-08

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 509 2.00 µg/L 500.00 0.0818 102 75-125

**Matrix Spike Dup (A005995-MSD1)**

Source: 17I0492-04

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 487 2.00 µg/L 500.00 0.245 97 75-125 1 20

**Matrix Spike Dup (A005995-MSD2)**

Source: 17I0493-08

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 502 2.00 µg/L 500.00 0.0818 100 75-125 1 20

**Batch A005996 - EPA 200.8 Metals****Blank (A005996-BLK1)**

Prepared: 09/28/201 Analyzed: 09/29/201

Lead U 2.00 µg/L

**LCS (A005996-BS1)**

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 507 2.00 µg/L 500.00 101 85-115

**Matrix Spike (A005996-MS1)**

Source: 17I0493-18

Prepared: 09/28/201 Analyzed: 09/29/201

Lead 513 2.00 µg/L 500.00 0.416 103 75-125

Prairie Analytical Systems, Inc.

Date: 10/3/2017

## LABORATORY RESULTS

Client: Aires Consulting Group

Project: 17-18349 Geneva High School

Lab Order: 17I0493

## Metals by ICP-MS - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	-------

## Batch A005996 - EPA 200.8 Metals

Matrix Spike Dup (A005996-MSD1)

Source: 17I0493-18

Prepared: 09/28/201 Analyzed: 09/29/201

Lead	507	2.00	µg/L	500.00	0.416	101	75-125	1	20	
------	-----	------	------	--------	-------	-----	--------	---	----	--

**Prairie Analytical Systems, Inc.****Date:** 10/3/2017

---

---

**LABORATORY RESULTS****Client:** Aires Consulting Group**Project:** 17-18349 Geneva High School**Lab Order:** 17I0493

---

**Notes and Definitions**

\* NELAC certified compound.

U Analyte not detected (i.e. less than RL or MDL).

**Chain of Custody Record**

Central IL - 1210 Capital Airport Drive - Springfield, IL 62707-8490 - Phone (217) 753-1148 - Facsimile (217) 753-1152  
 Chicago IL Office - 9114 Virginia Rd., Ste 112 - Lake in the Hills, IL 60156 - Phone (847) 651-2604 - Facsimile (847) 458-9680  
 Central / Southern IL Contact - Phone (217) 414-7762 - Facsimile (217) 753-1152



Client: Aires Consulting - Gallagher Bassett		Analysis and/or Method Requested: Lead in Drinking Water - IL		Reporting: <input type="checkbox"/> CCDD <input type="checkbox"/> Residential <input type="checkbox"/> Industrial / Commercial	
Address: 1550 Hubbard Ave				<input type="checkbox"/> A <input type="checkbox"/> D <input type="checkbox"/> B <input type="checkbox"/> E <input type="checkbox"/> C <input type="checkbox"/> F	
City, State, Zip Code: Batavia, IL 60510				<input type="checkbox"/> Residential <input type="checkbox"/> Industrial	
Phone / Facsimile: 630.879.3006				SAMPLER COMMENTS	
Project Name / Number: 17-18349					
Project Location: Geneva High School					
P.O. # or Invoice To: 17-18349					
Contact Person: Geoff Baccii II					
Sample Description: Date: Sampling Time: Matrix Code: Preserv Code: No. of Containers: Sample Type: Grab		X			
See attached Addendum ( 1 pages) for sample information (20 samples)					
<b>Unless otherwise noted:</b>					
Matrix Code: DW/					
Preservative Code: 0					
No. of containers per sample: 1					
Sample Type: Grab					
Analysis requested: Lead in Drinking Water					
Relinquished By: Nathan Herman		Date: 9/13/17		Time: 12:00 PM	
Relinquished By: Berger		Date: 9/15/17		Time: 12:35 PM	
Relinquished By: [Signature]		Date: 9/18/17		Time: 17:00	
Matrix Code: 0 - None		DW - Drinking Water		NA - Non-Aqueous Liquid	
Preservative Code: A - Aqueous		1 - HCl		3 - HNO3	
		GW - Ground Water		4 - NaOH	
		2 - H2SO4		5 - 5035 Kit	
O - Oil		X - Other (Specify)		X - Other (Specify)	
Date: 9/14/17		Date: 9/15/17		Date: 9-19-17	
Time: 2:30pm		Time: 12:35		Time: 10:45	
Method of Shipment: UPS		QC Level: 2		QC Level: 3	
On wet ice? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Turnaround Time: Standard <input checked="" type="checkbox"/> Rush <input type="checkbox"/>		Temperature (°C): 22.1	
Date Required: 10/2		Date Required: 3		Date Required: 4	

IS3E ID: 310453040260001  
 Building ID: 1  
 Building Description: Geneva High School  
 Sample Collecti: 9/12/2017  
 Collected by: Kathryn Herrmann

Sample Time (12 HR Clock)	Sample ID Number	Sample Location Description	Fixture Type	Date of Last Use	Time of Last Use (12 HR Clock)	Sample Type	Sample Volume (mL)	Notes
5:36 AM	✓ GHKS-1A	S. side - E corner	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:37 AM	✓ GHKS-1B	S. side - E corner	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:38 AM	✓ GHKS-2A	S. side - W corner	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:39 AM	✓ GHKS-2B	S. side - W corner	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:41 AM	✓ GHKS-3A	W. side - N corner	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:42 AM	✓ GHKS-3B	W. side - N corner	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:43 AM	✓ GHKS-4A	W. side - furthest up	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:44 AM	✓ GHKS-4B	W. side - furthest up	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:45 AM	✓ GHKS-5A	W. side - middle	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:46 AM	✓ GHKS-5B	W. side - middle	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:47 AM	✓ GHKS-6A	W. side - bottom	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:48 AM	✓ GHKS-6B	W. side - bottom	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:50 AM	✓ GHKS-7A	N. side - W corner	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:51 AM	✓ GHKS-7B	N. side - W corner	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:52 AM	✓ GHKS-8A	N. side - E corner	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:53 AM	✓ GHKS-8B	N. side - E corner	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
5:55 AM	✓ GHKS-9A	Spigot Near Stove	KS - Kitchen Sink	9/11/2017	2:00 PM	First Draw	250	
5:56 AM	✓ GHKS-9B	Spigot Near Stove	KS - Kitchen Sink	9/11/2017	2:00 PM	Flush	250	
6:07 AM	✓ GHSS-10A	Room EE180	S - Sink	9/11/2017	2:00 PM	First Draw	250	
6:08 AM	✓ GHSS-10B	Room EE180	S - Sink	9/11/2017	2:00 PM	Flush	250	